



# Existing biological nitrogen removal processes and current scope of advancement

Sandip Magdum, V. Kalyanraman

## ► To cite this version:

Sandip Magdum, V. Kalyanraman. Existing biological nitrogen removal processes and current scope of advancement. Research Journal of Chemistry and Environment, 2017, 21 (7), pp.43-53. hal-01883538

**HAL Id: hal-01883538**

**<https://hal.science/hal-01883538>**

Submitted on 10 Oct 2018

**HAL** is a multi-disciplinary open access archive for the deposit and dissemination of scientific research documents, whether they are published or not. The documents may come from teaching and research institutions in France or abroad, or from public or private research centers.

L'archive ouverte pluridisciplinaire **HAL**, est destinée au dépôt et à la diffusion de documents scientifiques de niveau recherche, publiés ou non, émanant des établissements d'enseignement et de recherche français ou étrangers, des laboratoires publics ou privés.

## Review Paper:

# Existing biological nitrogen removal processes and current scope of advancement

Magdum Sandip<sup>1,2\*</sup> and Kalyanraman V.<sup>2</sup>

1. Department of Technology, Savitribai Phule Pune University, Pune, INDIA

2. COE Biotechnology, R.D. Aga Research, Technology and Innovation Centre, Thermax Ltd., Pune, INDIA

\*sandip.magdum@thermaxglobal.com

## Abstract

*In India, to achieve the stringent norms of total nitrogen less than 10 mg/l in sewage treatment plant is a big challenge for the public - private facilities and organizations. After successful implementation of this norm the pollutant burden from rivers and natural water bodies certainly reduces. The use of conventional biological nitrogen removal (BNR) processes for new treatment facility development or retrofitting is also an energy and cost intensive practice. The process technologies offered by current market such as MLE, MBBR, IFAS and SBR are still in with downside of higher footprint, multi tank reactors, heavy instrumentation for IR and RAS which ultimately incur higher capital and operating cost. The current market need and lack of sustainable nitrogen removal applications, trigger to review the of all available efficient biological nitrogen removal processes. This review will gives an overall scenario of past and current biological nitrogen removal process technologies with showing possible scope and way forward towards more energy neutral nitrogen removal technologies.*

**Keywords:** Nitrogen removal, sewage, footprint, energy, sustainable

## Introduction

Underground water is already overexploited in the United States, India and China and providing the water needed to feed a growing population and balancing this with all the other demands on water, is one of the great challenges of this century<sup>38</sup>. People living in river basins under severe water stress are projected to more than double between 2000-2050, reaching 3.9 billion<sup>39</sup>. Almost one fifth of the world's population lacks the access to safe drinking water and this water crisis is leading to cause of death and disease in the world, with more than 14000 people dying each day<sup>38</sup>. Currently pressure for water is growing on natural systems and urgent steps must be taken to begin to implement tried and tested methods of wastewater treatment before the situation gets out of control. With the organic pollutants, fixed nitrogen such as ammonium and nitrate must be removed to avoid the eutrophication in water bodies.

Lower NH<sub>3</sub>-N concentration at 1.68 mg/l also showed its toxic effect on fish flora<sup>52</sup>. Ammonia also imparts an oxygen

demand in natural water systems because nitrifying bacteria will consume dissolved oxygen (DO) while oxidizing ammonia to nitrite and nitrate. Nitrate levels above 10 ppm may present a serious health concern for infants and pregnant or nursing women<sup>20</sup>.

Also, the current scenario of wastewater treatment is facing towards the development and use of energy efficient technologies. Method of pumping air into the wastewater is defined as aeration process and it takes 55.6% of total energy consumption in the wastewater treatment<sup>41</sup>. Further advanced treatment with nitrification required 40% more energy than conventional one<sup>15</sup>. In case of total nutrient removal, anoxic recycling for denitrification with anoxic or anaerobic mixing also increases the energy consumption. In recent times, the novel biological nitrogen removal (BNR) mechanisms were identified such as Simultaneous Nitrification-Denitrification (SND)<sup>25</sup>, Nitrification-Denitrification<sup>49</sup> and Nitrification-Anaerobic Ammonium Oxidation (ANAMMOX)<sup>32</sup> methods. These methods offer the economically attractive and environmentally friendly alternative to current wastewater treatment processes for the removal of fixed nitrogen<sup>29</sup>.

Current high rate wastewater treatment technologies include the moving bed biofilm reactor (MBBR) and integrated fixed film activated sludge (IFAS) process. The MBBR is known for completely mixed, continuously operated, compact and its simplicity of operation<sup>7,9,11</sup> with major benefits of lower footprint, high degradation/reaction rate, nitrifiers retention and its flexibility of operations at varying load. There are also some process disadvantages of MBBR such as high operating cost, chemical requirement, settlers for sludge separation and high sludge production. These energies and cost intensive limitations need to be minimized, to accept MBBR as an ideal process. The MBBR used for high rate COD or BOD removal applications and second reactor can be attached for nitrification whereas the IFAS process can be used for total nitrogen removal by using high hydraulic retention time (HRT) and as efficient nitrogen removal processes with a sludge recycling cost<sup>65</sup>.

The increasing demands of water and energy with increase of population will be unavoidable whereas the energy resources remain same. This paper reviews the current biological nitrogen removal processes used in wastewater treatment and scope for further sustainable development in nitrogen removal process.

## Existing Processes of Biological Nitrogen Removal

Conventional wastewater treatment systems for nitrogen removal require a lot of energy to create aerobic conditions for bacterial nitrification with use of organic carbon to remove nitrate by bacterial denitrification<sup>30</sup>. Major biological nitrogen removal process reactions are as follows:

**Nitrification – Denitrification:** Conventional nitrogen removal process follows the nitrification- denitrification pathway (Figure 1a) where the autotrophic two step nitrification is carried by *Nitrosomonas sp.* and *Nitrobacter sp.*


**Aerobic Denitrification:** Simultaneous nitrification and denitrification (SND) process occur concurrently in the same aerobic reactor inside of floc structure (Figure 2) which remove 80 to 96 % nitrogen without additional carbon and alkalinity requirement. The C:N ratio is required to be 10 and the bulk dissolved oxygen (DO) concentrations need to be maintained is between 0.3 mg/l to 0.7 mg/l<sup>25</sup>. The reaction depends on DO level, sludge size and diffusion barriers<sup>24</sup>.

**Nitritation – Denitritation:** The nitritation- denitritation process is also called as “Nitrite Shunt” which avoids the oxidation of nitrite to nitrate by nitrite oxidizing bacteria (NOB) and allows for the reduction of the formed nitrite to dinitrogen gas by heterotrophic denitrification (Figure 1b). It would decrease the organic carbon demand for total


nitrogen removal by 40%. Additionally, 25% of the aeration costs can be saved by avoiding nitrite oxidation<sup>62,70</sup>. It is reported that combination of controlled aeration phase length and DO at 15°C resulted in nitritation- denitritation reactions under aerobic granular sludge in SBR, resulted in total nitrogen removal efficiency of up to 95%<sup>33</sup>. Similar studies on nitritation – denitritation were carried out in SBR form of system with maximum 96% nitrogen removal with ammonia-rich landfill leachates<sup>13</sup>.

**Nitritation – ANAMMOX:** Application of anaerobic ammonium oxidizing (ANAMMOX) process for the treatment of high nitrogen strength wastewater is an emerging technology and scope for lower oxygen requirement. In the process (Figure 1c), aerobic ammonia oxidizing bacteria (AOB) oxidize half of the ammonia to nitrite which is used by ANAMMOX bacteria (*Candidatus Brocadia fulgida*) as electron acceptor for oxidizing the remaining ammonia to dinitrogen gas<sup>2</sup>.


The quantitative analysis of oxygen consumption in a partial nitrification-ANAMMOX biofilm process<sup>16</sup> and effect of granule size on autotrophic nitrogen removal<sup>66</sup> was studied in the ANAMMOX process. In 2014, the group of Delft University also reported the simultaneous partial nitritation and ANAMMOX process<sup>35</sup> with physiological and kinetic characterization of a suspended cell ANAMMOX reaction<sup>34</sup>.

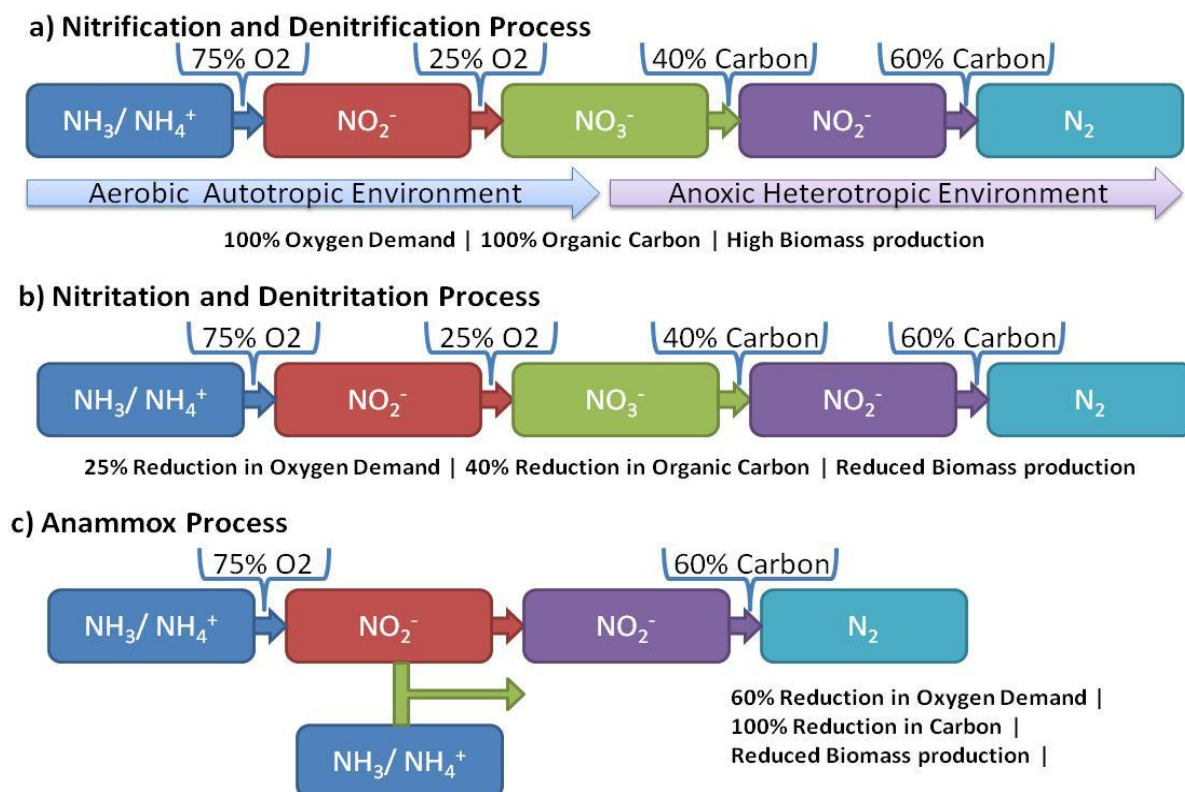

**Figure 1: Biological nitrogen removal reactions: a) Conventional biological nitrification and denitrification reaction, b) Nitrogen removal reaction by nitritation- denitritation process and c) Nitrogen removal reaction by ANAMMOX process**

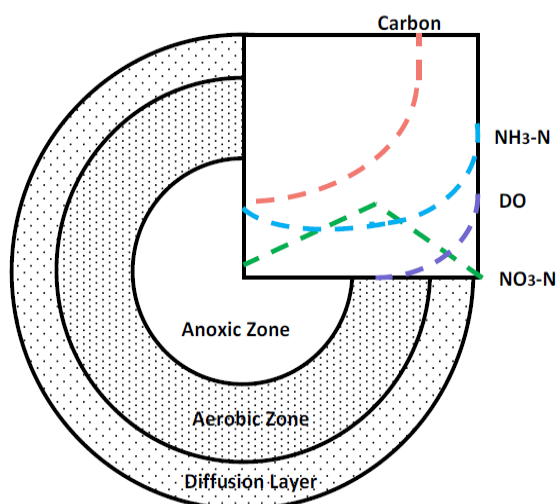

**Figure 2: Diffusion of DO and substrate within the floc during SND process<sup>24</sup>**

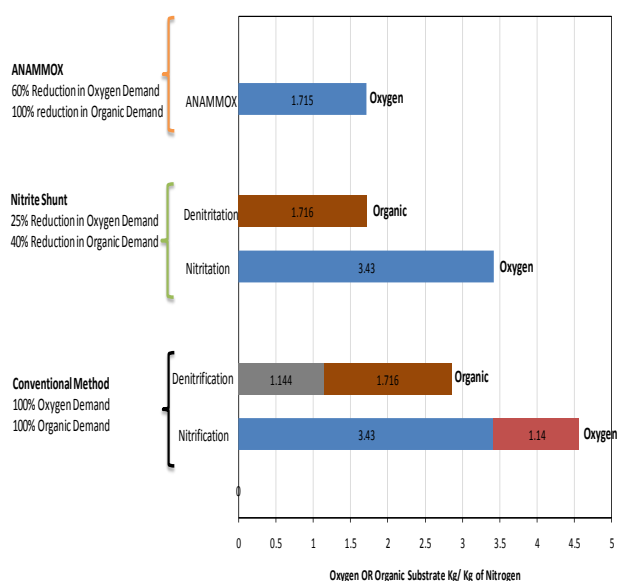

**Figure 3: Comparison of oxygen and organic demands of different biological nitrogen removal processes**

It is imperative to compare the significance of advance processes such as nitrification-denitrification and ANAMMOX with conventional processes. It is evident from figure 3 that the advance processes show considerable reduction in demand of oxygen and organic substrate. The oxygen requirement for nitrification of ammonia is 4.57 g O<sub>2</sub> /g N oxidized (3.43 g O<sub>2</sub>/ gm of Ammonia oxidized to nitrite and 1.14 g O<sub>2</sub> / g NO<sub>2</sub> oxidized to nitrate).<sup>63</sup> Produced nitrate is further denitrified by heterotrophic microbes with the stoichiometric requirement of 2.86 g COD/g N<sup>44</sup> whereas the nitrification- denitrification process requires 1.761 g COD/g N of organic. The ANAMMOX process further reduces the oxygen requirement by 60% with no need of organic substrate.

The current approach should be towards use of low oxygen and carbon utilizing systems which are beneficiary for saving energy and avoiding environmental pollution.

**Engineered biological nitrogen removal processes:** Based on the known reactions many systems were engineered and applied for advance nitrogen removal in wastewater treatment. There are two major types of microbial growth process available in biological wastewater treatment which are a) biofilm based and b) granular sludge based, however, recent development also moved towards with c) a hybrid process which uses both biofilm and sludge based approach to treat the wastewater (Figure 4).

**Biofilm based processes:** Technologies such as Submerged Aerobic Fixed Film Reactor (SAFF), Trickling filters and biofilters are commonly known as fixed film processes in wastewater treatment. A nitrogen removal study from centrate type of wastewater with the use of a submerged attached growth bioreactor has shown 85% of average total nitrogen removal<sup>45</sup>. A recent study showed the nitrogen removal of 52–54% was reached in a partial nitrification in sponge-bed trickling filters (STF)<sup>54</sup>. Also, a report shows the enhanced nitrogen removal over 60% in conventionally designed trickling filter plants<sup>9</sup>.

In the tertiary denitrifying biofilters, the studies show up to 82% of nitrate nitrogen (NO<sub>3</sub>-N) removal<sup>55</sup>. A biofilter containing ammonia-oxidizing bacterial (AOB) and nitrite-oxidizing bacterial (NOB) communities was studied and resulted in 59.8–82.1% of total N removal efficiencies<sup>67</sup>. However, fixed film reactors are inadequately used for nitrification-denitrification because of the difficulty in maintaining an anoxic environment.

The fluidized bed bioreactors or moving bed bioreactors (MBBR) and biofilm based air-lift reactor were reported in 1994 for nitrification<sup>19</sup>. In the evolution of MBBR process development, studies for nitrification-denitrification, cold climate nitrogen removal, biofilm carriers and oxygen addition<sup>4</sup>, sequencing batch MBBR, biological nitrogen removal<sup>18</sup> were established.

Further biofilm based study includes nitrification in biofilms<sup>60</sup>, SRT and biofilm growth with suspended biomass in biofilm reactors<sup>61</sup>, biofilm detachment study<sup>14</sup>. Effects of varying substrate loading rates, influence of dissolved oxygen concentration on nitrite accumulation<sup>47</sup>, mathematical modeling of biofilm structures<sup>41</sup> have been accomplished for development of modern wastewater treatment methods.

The effect of ammoniacal nitrogen loading rate from 0.2 to 0.4 kg NH<sub>4</sub>-N/(m<sup>3</sup>.d) was studied on Kaldnes K1 and Mutag Biochip type of carrier media and resulted with total nitrogen removal amounting up to 86 and 73% respectively<sup>6</sup>. Cubic-shaped polyurethane sponges were also used as biofilm carriers in a MBBR and achieved total nitrogen removal up to 86.7% and correspondingly, SND was 93.3 %<sup>71</sup>. The application of conventional MBBR processes for nitrification and nutrient-removal is shown in figure 7.

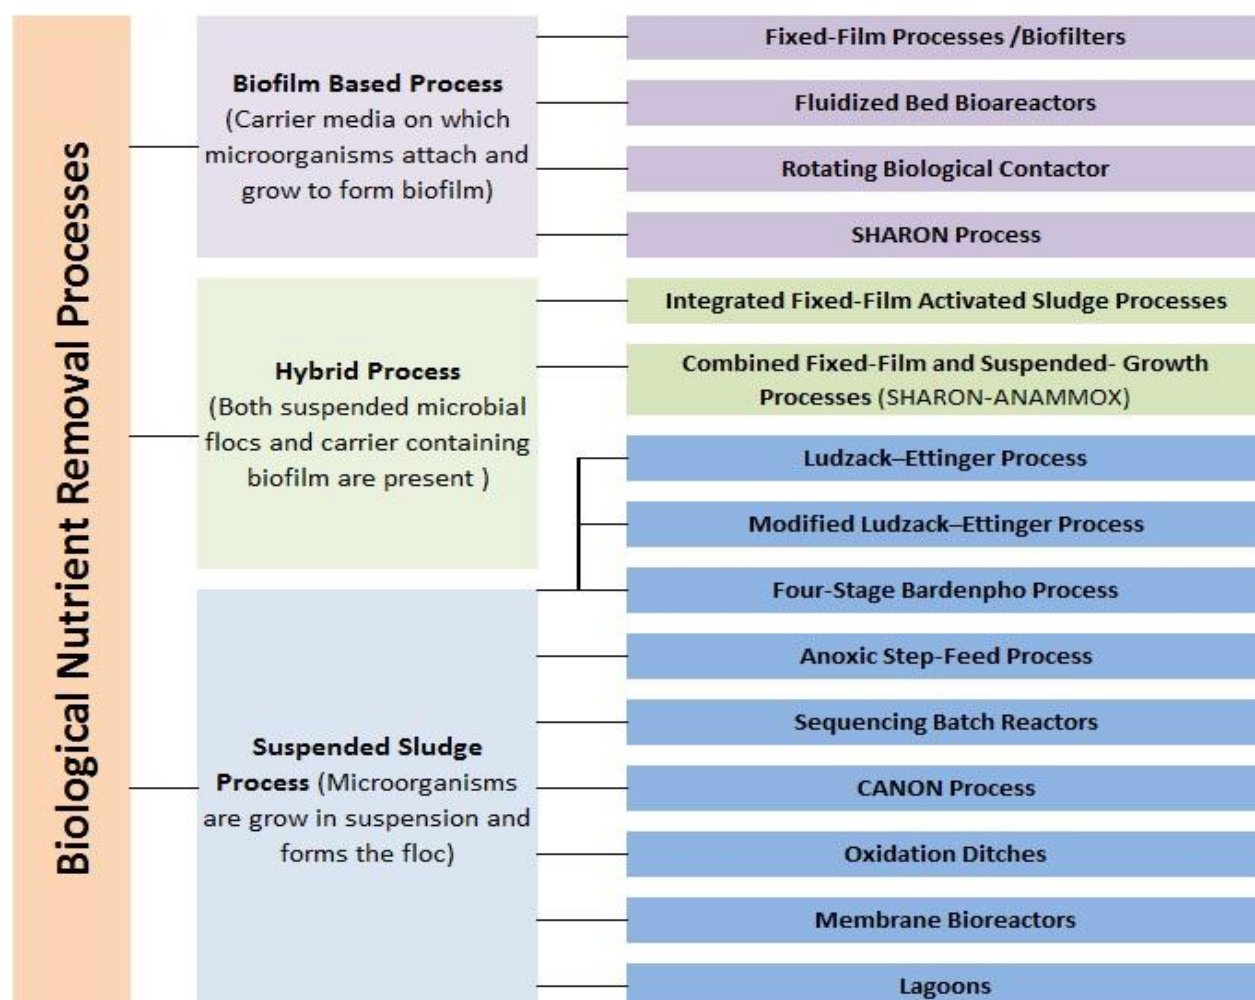


Figure 4: Current applied processes and technologies for biological nitrogen removal.

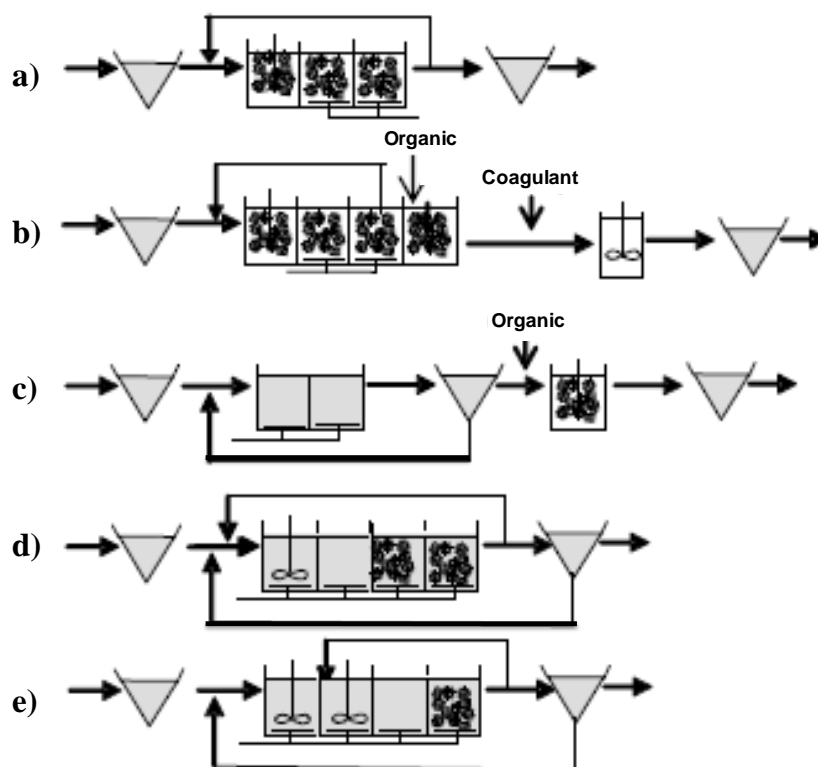


Figure 5: Flow diagrams for MBBR and IFAS processes for nitrogen removal applications<sup>43</sup>



MBBR processes are often preferred in green-field plants for nitrogen removal in A<sub>2</sub>O (Anoxic- Oxic-Oxic) mode (Figure 5a). Sometimes to achieve more stringent nitrate removal pre-anoxic reactor with internal recycling (IR) followed by post-anoxic reactor with external carbon addition is often practiced (Figure 5b) in order to achieve effective denitrification. Anoxic MBBR can be used after nitrifying activated sludge plants as post-denitrification tool with external COD addition (Figure 5c) for denitrification. The SHARON process (single reactor system for high ammonia removal over nitrite process) is a biofilm based process of biological nitrification- denitrification (Figure 6a).

To obtain these stable reactions, the operating variables (temperature, pH, hydraulic retention time, substrate concentration, dissolved oxygen) are controlled in a chemostat operation with carrier media and stirrer<sup>17</sup>. But unfortunately, controlling of these process variables can be very difficult in large scale plant operations<sup>57</sup>.

**Hybrid processes:** Recent study of Integrated Fixed-Film Activated Sludge (IFAS) MBBR technology has been explored to optimize various operating conditions by combining biofilm systems with activated sludge process and WAS recycling<sup>12</sup>. IFAS process enables activated sludge systems to achieve higher treatment efficiency without increasing MLSS concentration in the process. A performance evaluation study for biological nitrogen removal in an integrated fixed-film activated sludge and moving-bed sequencing batch biofilm reactor (IFAS-MBSBBR) obtained overall nitrogen removal efficiency up to 91.4%<sup>48</sup> to 91.7%<sup>58</sup>.

Combined SHARON and ANAMMOX process (Figure 6b) also practiced where the effluent from SHARON reactor containing a mixture of ammonium and nitrite is ideally suited as the influent for the ANAMMOX process where

ammonium and nitrite are anaerobically converted to dinitrogen gas by ANAMMOX bacteria<sup>31</sup>. Again, the requirements of higher nitrogen load and stringent process control are restrictions of this process. MBBR-based IFAS processes are mostly used for up-gradation of activated sludge plant in order to achieve total nitrogen removal (Figure 5d) or total nutrient (N and P) removal (Figure 5e). A sewage treatment study of ANAMMOX - MBBR and ANAMMOX – IFAS processes was attempted to compare the efficiency of biofilm based competitive reactions of nitrification/ANAMMOX biofilm in presence of granular sludge<sup>30</sup>. Figure 8 shows the ANAMMOX biofilm process with MBBR and IFAS based approach.

Lower C/N ratio is a pre-requisite of de-ammonification reactions. The de-ammonification process in MBBR (Figure 7a) uses the suspended carriers which reduce the foot print of the system. But, the diffusion limitation of NO<sub>2</sub>-N in the biofilm may occur for ANAMMOX bacteria which will be possible rate limiting step in MBBR ANAMMOX process. The first full scale demonstration plant was built in Hattingen in Germany and was implemented as IFAS-based ANAMMOX process (Figure 7b) designed in such a way that the aerobic ammonium-oxidizing bacteria are enriched in the suspended activated sludge and the anaerobic ammonium-oxidizing (ANAMMOX) bacteria are enriched on a biofilm.

The side stream process at Sjölanda WWTP (Sweden) used IFAS – ANAMMOX process for treating reject water from sludge digestion with a removal capacity exceeding 2 kg N/m<sup>3</sup>.d<sup>8</sup>. Till date 100 full-scale installations are in operation worldwide with partial nitrification/ANAMMOX (PN/A) process. All were implemented and optimized for high-strength ammonium wastewaters with low C/N ratios and elevated temperatures<sup>32</sup>.

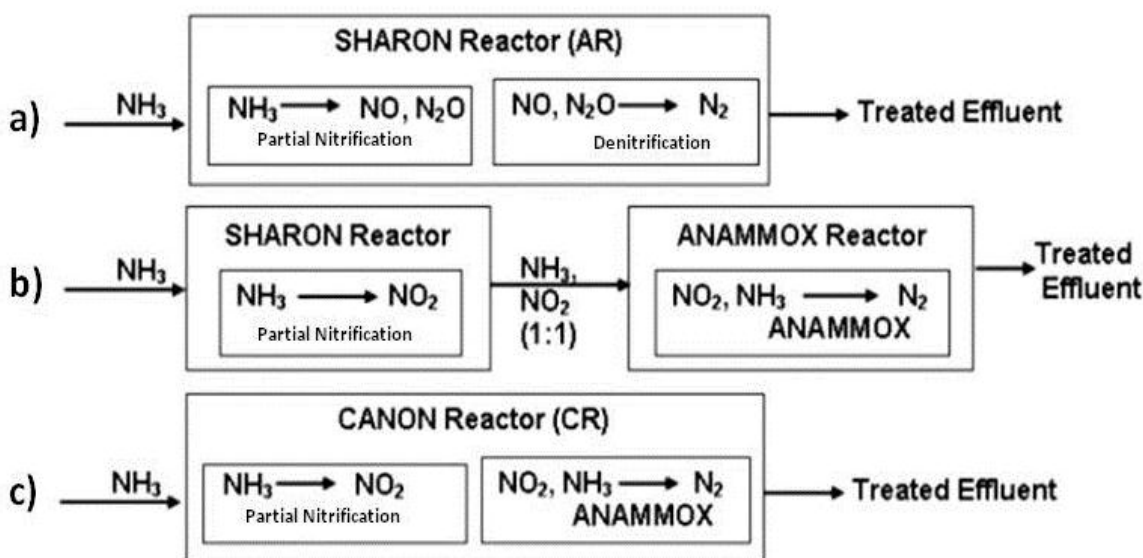


Figure 6: Process block diagrams of advanced biological nitrogen removal processes, namely the (a) SHARON process, (b) SHARON-ANAMMOX process, (c) CANON process<sup>5</sup>

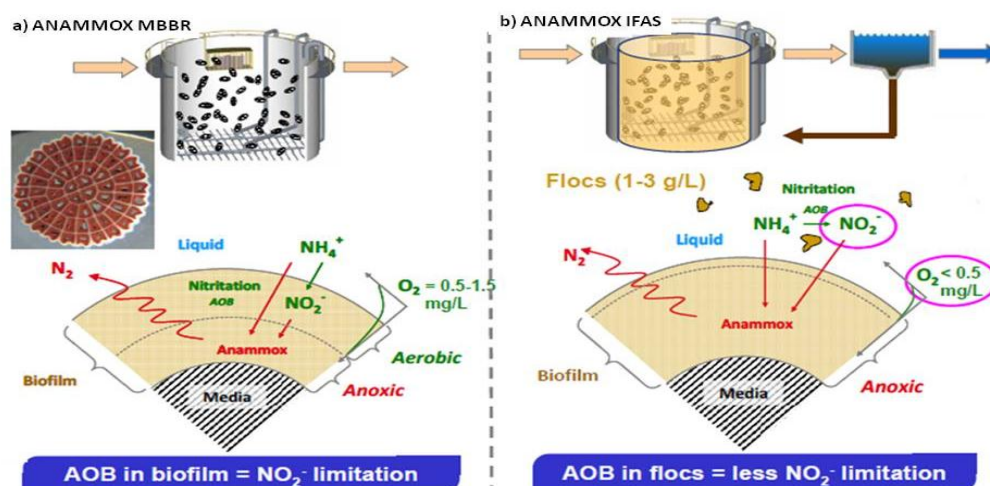


Figure 7: ANAMMOX reactions with MBBR and IFAS processes<sup>8</sup>

Although ANAMMOX process is showing great advantages in terms of energy saving in nitrogen removal, the process sensitivity and controlling parameters to effective reactions are current big challenges to encounter. Some impacting parameters such as pH shock, temperature variation, influent solids concentration and mixing problems are interrupting the plant performance. Some process controlling issues in actual ANAMMOX based nitrogen removal plants are: a) 30% plants have  $\text{NH}_4^+$  build up issues, b) 50% plants have  $\text{NO}_3^-$  and  $\text{NO}_2^-$  build-up issues, c) 30 - 35% plants have scaling and foaming issues and d) 45% plants have sludge retention/settling/solids separation issues<sup>32</sup>.

It has been reported that growth of ANAMMOX bacteria can be inhibited due to inhibition of the ammonium oxidizing bacteria and subsequent ammonia increase in reactor<sup>27</sup>. ANAMMOX process is effectively applied for nitrogen removal in various plants but further optimizing operational conditions need to be focused for increasing its practical sturdiness.

**Suspended sludge processes:** The conventional nitrogen removal processes such as Ludzack–Ettinger, Modified Ludzack–Ettinger (MLE), Four-Stage Bardenpho and Anoxic Step-Feed Processes are based on activated sludge philosophy with larger reactor volumes but they are very adaptable to retrofit in existing activated sludge process (ASP). In these systems, lack of fine control on internal recycle flow with anoxic DO control is the major limitation to achieve efficient denitrification. The pre- and post-denitrification plants (Figure 8) were studied by Rusten and Ødegaard stating that the parameters such as DO concentration,  $\text{NO}_x\text{-N}$  ( $\text{NO}_2\text{-N} + \text{NO}_3\text{-N}$ ) concentration, concentration of organic matter and operating temperature influence the denitrification process<sup>55</sup>. Another study also concluded the dissolved oxygen of internal recirculation loop significantly reduces the anoxic denitrification rate<sup>64</sup>.

Efficient total nitrogen removal in a pre-denitrification process is a function of internal recirculation ratios where it

is typically limited to 100 to 200% of the influent flow depending on temperature and wastewater composition. The continuous operation of IR pump also incurs the additional cost to the overall treatment. In post-denitrification process, the addition of external carbon source such as methanol or ethanol is necessary.

Due to the significantly shorter start-up time and higher denitrification rates, ethanol will be the best external carbon source for post-denitrification in geographic markets where the ethanol is cost competitive; otherwise addition of external carbon source increases the operating cost<sup>43</sup>. The external carbon source addition needs to be controlled constantly to achieve the effective denitrification and to avoid surplus organic buildup. These pre- and post-denitrification processes also need higher footprint and trains of separate chambers to carryout reactions in separate zones.

Sequencing batch reactor (SBR) is a current alternate to activated sludge process which is gaining popularity due to its high-quality treatment performance and complete possible automation. SBR process consists of four steps namely feeding, aeration, settling and discharge of the treated effluent. It is an advanced cyclic activated sludge process which is working on typical batch process carrying SND phenomenon at different cycle phase<sup>36</sup>.

In certain cases, multiple SBR reactors are used simultaneously for continuous treatment operation and at least one reactor is fed at each moment. SBR is a known tool for biological carbon and nutrient removal, capable of achieving effluents with very low nitrogen and phosphorus concentrations from highly concentrated wastewaters<sup>42</sup>. At feed phase, reactor meets high BOD and zero DO condition which is suitable for denitrification and become anaerobic for phosphate release. In the aeration phase, phosphate uptake reaction is followed by COD oxidation and nitrification (Figure 9). This SBR cycle design has the advantage of selector phase biology<sup>36</sup>.

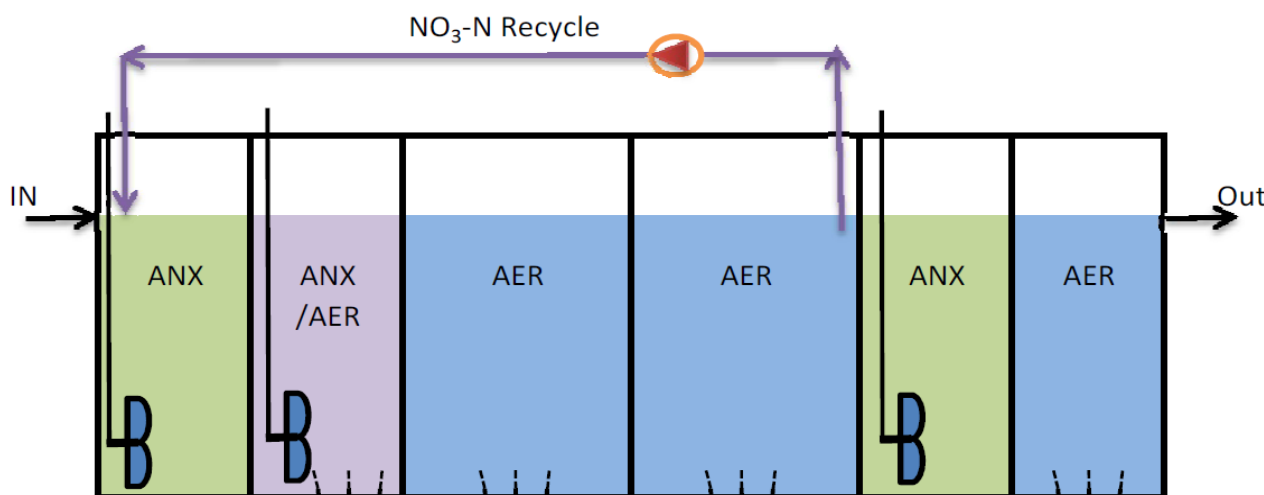


Figure 8: Nitrogen removal in combined pre- and post-denitrification MBBR process

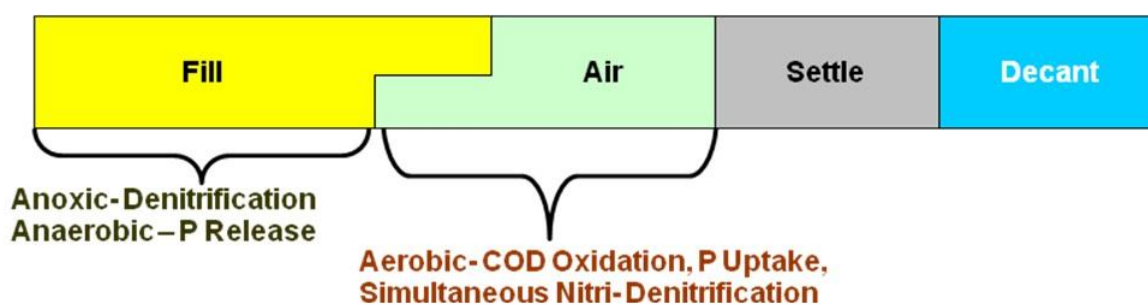


Figure 9: SBR cycle design for the advantage selector phase biology<sup>36</sup>

Use of ANAMMOX process with SBR operation philosophy was also attempted such as CANON SBR process. CANON (completely autotrophic nitrogen removal over nitrite) process (Figure 6c) relies on a stable interaction between the two groups of autotrophic microorganism populations where the nitrification and ANAMMOX reactions are carried out under oxygen limited conditions<sup>59</sup>. SBR was operated with an ammonium-rich wastewater with CANON process and achieved nitrogen removal rate of up to 0.3 kg N/m<sup>3</sup>.d<sup>56</sup>. Slow reaction rate, controlling biomass population and strict DO control (< 0.5 mg/l) are the limiting factors of this process.

A recent study showed the simultaneous partial nitrification, ANAMMOX and denitrification processed effectively carried out in a SBR<sup>69</sup>. SBR is the easy batch process with need of longer reactor HRT and overall higher footprint where it might require effluent equalization before filtration. Also, SBR needs higher sophisticated instrumentation to handle complex process design with reliable decanting system.

Although the present Nitrification/ ANAMMOX process is known for most efficient way of nitrogen removal, it demands and is restricted to its reaction requirements of higher HRT, lower C/N ratio, higher influent ammonium concentration<sup>26,32</sup>. ANAMMOX process for nitrogen removal from sewage at higher C/N ratio is not yet well established. In the case of nitrification/denitrification study, the

usefulness of an intermittent aeration strategy for achieving nitrite accumulation remains unknown<sup>46</sup>. The one-step partial nitrification/ANAMMOX or de-ammonification process is challenging to control because of the competing reactions of ANAMMOX, ammonia-oxidizing (AOB), nitrite-oxidizing (NOB) and denitrifying bacteria that reside in a bioreactor<sup>39</sup>.

Further study should focus on determining process control parameters for the optimal operation of nitrification-ANAMMOX bioreactors under variable wastewater conditions such as lower temperature and high C/N ratio<sup>21</sup>. The process parameters required to control the energy efficient nitrogen removal are still not achieved to its possible optimum. Higher HRT, lower C/N ratio, controlling internal recycle and stabilizing different bacterial population on actual plant conditions are some of parameters needed to consider for further research.

#### Modeling of biological nitrogen removal processes:

Biological nitrogen removal process modeling is a current requisite for better process selection, treatment predictions and gives a platform for better management of treatment responses in a short time. A series of activated sludge models (i.e. ASM1, ASM2, ASM2d, ASM3) developed by International Water Association (IWA), have been considered as good tools for correlating the complexity of the activated sludge processes and the prediction of biological treatment efficiency under dynamic conditions. A



more complex ASM2d and ASM3 has occurred to describe the biological nitrogen removal processes<sup>68</sup>. Many factors such as HRT, % removal, air flow rate, MLSS in the reactor, SRT and organic or nitrogen loading rates are to be analyzed in these models to achieve optimum process parameters.

The mathematical and program based modeling tools are also available to understand the complex interdependent biological processes. Results of a single air lift bioreactor carrying SND process were completely analyzed using analysis of variance (ANOVA) by Design Expert software. From this analysis, three-dimensional plots were obtained based on the effect of the levels of the two factors and the simultaneous interaction of the two factors on the treatment responses<sup>3</sup>. The comparative studies with activated sludge model (ASM)<sup>10</sup> and one-dimensional multispecies biofilm reactor model<sup>23</sup> have given better understanding of simultaneous nitrogen removal process reactions. In a model based evaluation of shortcut nitrogen removal processes, the two control schemes were evaluated; one was based on online measured ammonia and the other was based on a target ratio of ammonia vs. NO<sub>x</sub> (AVN). The results promote better management of incoming organics and bicarbonate for a more efficient NOB out-selection<sup>1</sup>.

Kagawa et al<sup>28</sup> coupled two computational models for biological nitrogen removal study in the SBR with anaerobic–aerobic–anoxic cycles with different spatial and temporal scales. The results of this study indicated the stability of nutrient removal process using microbial granules depending largely on the DO concentration during the aerobic period. Regmi et al<sup>50</sup> evaluated the aeration control strategies: 1) DO setpoint control or conventional aeration control (CAC); 2) Ammonia-based aeration control (ABAC); and 3) AVN control. After experimentation, the comparison of these strategies in terms of effluent total nitrogen concentrations, aeration demand, alkalinity demand nitrite-shunt was done and the results showed the insights on the advantages and limitations of each aeration control strategy. This type of modeling analysis completely avoids the time consuming wet or pilot experimentations.

Huang et al<sup>22</sup> compared the ANAMMOX based nitrogen removal experimental performance, with Monod model modified Stover–Kincannon model, first-order kinetics and the Grau second-order substrate removal model. Based on analysis, Monod model, modified Stover–Kincannon model and the Grau second-order model proved to be more appropriate to describe the nitrogen removal kinetics of the reactor than first-order model with high determination coefficients of 0.993, 0.993 and 0.991 respectively. Applications of these models will give rapid understanding with thorough comparative analysis of the different biological nitrogen removal processes. So, there is a need for further advancement of bioprocess based nitrogen removal models which can be easily applied towards precise selection of process parameters and modification with more feasible and cost-effective way.

## Conclusion

To evade eutrophication for river protection and other water bodies, nitrogen removal need should be mandatory for every wastewater treatment facility. The review highlights the conventional methods and processes that are practiced for the purpose of BOD and nitrogen removal, pay higher energy cost and also capital intensive. The most popular biological process technologies such as high rate biofilm based MBBR, hybrid suspended growth - biofilm based IFAS and suspended growth based MLE and SBR are the current choices to aim the nitrogen removal. But these processes follow the conventional biology of nitrification and denitrification where each reaction incurs the cost to create separate environment.

A need exists to evolve new process for nitrogen removal which should be more energy neutral and cost effective through exploiting current knowledge and smart engineering.

In this sphere, the granular sludge process technology opens the promising space with simultaneous nitrification-denitrification (SND) mechanism and creates scope for further research in varied areas such as achieving sludge granulation in actual plant conditions, controlling granule size, achieving CSTR conditions, maintaining low DO, sludge recycling and lowering the overall footprint.

## References

1. Al-Omari A., Wett B., Nopens I., De Clippeleir H., Han M., Regmi P., Bott C. and Murthy S., Model-based evaluation of mechanisms and benefits of mainstream shortcut nitrogen removal processes, *Water Sci. Technol.*, **71**(6), 840-847 (2015)
2. Almstrand R., Persson F., Daims H., Ekenberg M., Christensson M., Wilén B.M., Sörensson F. and Hermansson M., Three-dimensional stratification of bacterial biofilm populations in a moving bed biofilm reactor for nitrification-anammox, *Int. J. Mol. Sci.*, **15**, 2191–2206 (2014)
3. Asadi A., Zinatizadeh A.A. and Van Loosdrecht M., High rate simultaneous nutrients removal in a single air lift bioreactor with continuous feed and intermittent discharge regime: Process optimization and effect of feed characteristics, *Chem. Eng. J.*, **301**, 200–209 (2016)
4. Bagchi S., Biswas R. and Nandy T., Autotrophic Ammonia Removal Processes: Ecology to Technology, *Crit. Rev. Environ. Sci. Technol.*, **42**, 1353–1418 (2012)
5. Asoy A., Odegaard H., Haegh M., Risla F. and Bentzen G., Upgrading wastewater treatment plants by the use of biofilm carriers, oxygen addition and pre-treatment in the sewer network, *Water Sci. Technol.*, **37**(9), 159-166 (1998)
6. Bassin J.P., Dias I.N., Cao S.M.S., Senra E., Laranjeira Y. and Dezotti M., Effect of increasing organic loading rates on the performance of moving-bed biofilm reactors filled with different support media: Assessing the activity of suspended and attached biomass fractions, *Process Saf. Environ. Prot.*, **100**, 131–141 (2016)

7. Chen S., Sun D. and Chung J.S., Simultaneous removal of COD and ammonium from landfill leachate using an anaerobic-aerobic moving-bed biofilm reactor system, *Waste Manag.*, **28**, 339–346 (2008)
8. Christensson M., Ekström S., Andersson Chan A., Le Vaillant E. and Lemaire R., Experience from start-ups of the first ANITA Mox plants, *Water Sci. Technol.*, **67**, 2677–2684 (2013)
9. Dai Y., Constantinou A. and Griffiths P., Enhanced nitrogen removal in trickling filter plants, *Water Sci. Technol.*, **67**(10), 2273–2280 (2013)
10. Dapena-Mora A., Van Hulle S.W., Luis Campos J., Mendez R., Vanrolleghem P.A. and Jetten M., Enrichment of Anammox biomass from municipal activated sludge: experimental and modelling results, *J. Chem. Technol. Biotechnol.*, **79**(12), 1421–1428 (2004)
11. Delnavaz M., Ayati B. and Ganjidoust H., Prediction of moving bed biofilm reactor (MBBR) performance for the treatment of aniline using artificial neural networks (ANN), *J. Hazard Mater.*, **179**(1), 769–775 (2012)
12. Di Trapani D., Christensson M., Torregrossa M., Viviani G. and Ødegaard H., Performance of a hybrid activated sludge/biofilm process for wastewater treatment in a cold climate region: Influence of operating conditions, *Biochem. Eng. J.*, **77**, 214–219 (2013)
13. Fudala-Ksiazek S., Luczkiewicz A., Fitobor K. and Olanczuk-Neyman K., Nitrogen removal via the nitrite pathway during wastewater co-treatment with ammonia-rich landfill leachates in a sequencing batch reactor, *Environ. Sci. Pollut. Res. Int.*, **21**(12), 7307–7318 (2014)
14. Gjaltema A., Tjihuis L., van Loosdrecht M.C. and Heijnen J.J., Detachment of biomass from suspended nongrowing spherical biofilms in airlift reactors, *Biotechnol. Bioeng.*, **46**(3), 258–269 (1995)
15. Halim D., Energy Recovery in Wastewater Treatment, City Coll, New York, The City College of New York (2012)
16. Hao X., Cao X.C.P. and Loosdrecht M.C.M. van, Model-based evaluation of oxygen consumption in a partial nitrification Anammox biofilm process, *Water Sci. Technol.*, **52**(7), 115–160 (2005)
17. Hellinga C., Schellen A.A.J.C., Mulder J.W., Van Loosdrecht M.C.M. and Heijnen J.J., The SHARON process: an innovative method for nitrogen removal from ammonium-rich waste water, *Water Sci. Technol.*, **37**(9), 135–142 (1998)
18. Helness H. and Ødegaard H., Biological phosphorus and nitrogen removal in a sequencing batch moving bed biofilm reactor, *Water Sci. Technol.*, **43**(1), 233–240 (2001)
19. Hem L.J., Rusten B. and Ødegaard H., Nitrification in a moving bed biofilm reactor, *Water Res.*, **28**(6), 1425–1433 (1994)
20. Hord N.G., Ghannam J.S., Garg H.K., Berens P.D. and Bryan N.S., Nitrate and Nitrite Content of Human, Formula, Bovine, and Soy Milks: Implications for Dietary Nitrite and Nitrate Recommendations, *Breastfeed. Med.*, **6**(6), 393–399 (2011)
21. Hu Z., Lott T., de Kru M., Kleerebeze R., van Loosdrecht M., Kruit J., Jetten M.S.M. and Kartal B., Nitrogen removal by a nitrification-anammox bioreactor at low temperature, *Appl. Environ. Microbiol.*, **79**(8), 2807–12 (2013)
22. Huang X.W., Wei Q.Y., Urata K., Tomoshige Y., Zhang X.H. and Kawagoshi Y., Kinetic study on nitrogen removal performance in marine anammox bacterial culture, *J. Biosci. Bioeng.*, **117**(3), 285–291 (2014)
23. Isanta E., Reino C., Carrera J. and Pérez J., Stable partial nitrification for low-strength wastewater at low temperature in an aerobic granular reactor, *Water Res.*, **80**, 149–158 (2015)
24. Jimenez J., Bott C., Regmi P. and Rieger L., Process Control Strategies for Simultaneous Nitrogen Removal Systems, *Proc. Water Environ. Fed.*, **4**, 492–505 (2013)
25. Jimenez J., Dursun D., Dold P., Bratby J., Keller J. and Parker D., Simultaneous Nitrification-Denitrification to Meet Low Effluent Nitrogen Limits: Modeling, Performance and Reliability, *Proc. Water Environ. Fed.*, **15**, 2404–2421 (2010)
26. Johnson T., Sanjines P., Castaneda G. and Daigger G., A Universal SBR Design Concept for Sidestream Nitrogen Removal, In NC AWWA-WEA 90th Annual Conference, Winston-Salem, NC (2010)
27. Joss A., Derlon N., Cyprien C., Burger S., Szivak I., Traber J., Siegrist H. and Morgenroth E., Combined nitrification–anammox: advances in understanding process stability, *Environmental Science & Technology*, **45**(22), 9735–9742 (2011)
28. Kagawa Y., Tahata J., Kishida N., Matsumoto S., Picioreanu C., van Loosdrecht M.C.M. and Tsuneda S., Modeling the nutrient removal process in aerobic granular sludge system by coupling the reactor- and granule-scale models, *Biotechnol. Bioeng.*, **112**, 53–64 (2015)
29. Kartal B., Keltjens J.T. and Jetten M.S., The Metabolism of Anammox, In eLS (2008)
30. Kartal B., Kuenen J.G. and van Loosdrecht M.C.M., Engineering. Sewage treatment with anammox, *Science*, **328**, 702–703 (2010)
31. Khin T. and Annachhatre A.P., Novel microbial nitrogen removal processes, *Biotechnol Adv.*, **22**, 519–532 (2004)
32. Lackner S., Gilbert E.M., Vlaeminck S.E., Joss A., Horn H. and van Loosdrecht M.C.M., Full-scale partial nitrification/anammox experiences—an application survey, *Water Res.*, **55**, 292–303 (2014)
33. Lochmatter S., Maillard J. and Holliger C., Nitrogen removal over nitrite by aeration control in aerobic granular sludge sequencing batch reactors, *Int. J. Environ. Res. Public Health*, **11**, 6955–6978 (2014)
34. Lotti T., Kleerebezem R., Lubello C. and van Loosdrecht M.C.M., Physiological and kinetic characterization of a suspended cell anammox culture, *Water Res.*, **60**, 1–14 (2014)

35. Lotti T., Kleerebezem R., van Erp Taalman Kip C., Hendrickx T.L.G., Kruit J., Hoekstra M. and van Loosdrecht M.C.M., Anammox growth on pretreated municipal wastewater, *Environ. Sci. Technol.*, **48**, 7874–80 (2014)
36. Magdum S.S., Varigala S.K., Minde G.P., Bornare J.B. and Kalyanraman V., Evaluation of Sequential Batch Reactor (SBR) Cycle Design to Observe the Advantages of Selector Phase Biology to Achieve Maximum Nutrient Removal, *Int. J. Sci. Res. Environ. Sci.*, **3**, 234–238 (2015)
37. Magrath J., Water: A Shared Responsibility, The United Nations World Water Development, Report 2 (2007)
38. Marchal V., Dellink R., Van Vuuren D., Clapp C., Chateau J., Magné B. and van Vliet J., OECD environmental outlook to 2050, Organ. Econ. Co-operation Dev. (2012)
39. Melcer H., Bott C.B., Regmi P., Rieger L., Wan J., Johnson C., Chandran K. and Ma Y., Measuring Nitrite - The Key to Controlling Deammonification Systems, *Proc. Water Environ. Fed.*, **4**, 748–757 (2013)
40. Metcalf Eddy, Tchobanoglous G., Burton F.L. and Stensel H.D., Wastewater Engineering: Treatment and Reuse, 4th ed., McGraw-Hill Education, Boston (2003)
41. Morgenroth E., Eberl H.J., van Loosdrecht M.C.M., Noguera D.R., Pizarro G.E., Picioreanu C., Rittmann B.E., Schwarz A.O. and Wanner O., Comparing biofilm models for a single species biofilm system, *Water Sci. Technol.*, **49**, 145–154 (2004)
42. Obaja D., Macé S., Costa J., Sans C. and Mata-Alvarez J., Nitrification, denitrification and biological phosphorus removal in piggery wastewater using a sequencing batch reactor, *Bioresour. Technol.*, **87**, 103–111 (2003)
43. Ødegaard H., Compact wastewater treatment with MBBR, In International DSD Conference on Sustainable Storm water and Wastewater Management (2014)
44. Pan M., Wen X., Wu G., Zhang M. and Zhan X., Characteristics of nitrous oxide (N<sub>2</sub>O) emission from intermittently aerated sequencing batch reactors (IASBRs) treating slaughterhouse wastewater at low temperature, *Biochem. Eng. J.*, **86**, 62–68 (2014)
45. Pedros P.B., Onnis-Hayden A. and Tyler C., Investigation of Nitrification and Nitrogen Removal from Centrate in a Submerged Attached-Growth Bioreactor, *Water Environ. Res.*, **80**, 222–228 (2008)
46. Peng Y., Guo J., Horn H., Yang X. and Wang S., Achieving nitrite accumulation in a continuous system treating low-strength domestic wastewater: switchover from batch start-up to continuous operation with process control, *Appl. Microbiol. Biotechnol.*, **94**, 517–26 (2012)
47. Picioreanu C., Vanloosdrecht M. and Heijnen J., Modelling the effect of oxygen concentration on nitrite accumulation in a biofilm airlift suspension reactor, *Water Sci. Technol.*, **36**, 147–156 (1997)
48. Podedworna J., Zubrowska-Sudol M., Sytek-Szmeichel K., Gnida A., Surmacz-Górska J. and Marciocha D., Impact of multiple wastewater feedings on the efficiency of nutrient removal in an IFAS-MBSBBR: number of feedings vs. efficiency of nutrient removal, *Water Sci. Technol.*, **74**(6), 1457–1468 (2014)
49. Regmi P., Miller M.W., Holgate B., Bunce R., Park H., Chandran K., Wett B., Murthy S. and Bott C.B., Control of aeration, aerobic SRT and COD input for mainstream nitrification/denitrification, *Water Res.*, **57**, 162–171 (2014)
50. Regmi P., Sadowski M., Jimenez J., Wett B., Murthy S. and Bott C.B., Aeration control strategies for nitrogen removal: A pilot and model based investigation, *Proc. Water Environ. Fed.*, **3**, 1–5 (2015)
51. Rodrigues R.V., Romano L.A., Schwarz M.H., Delbos B. and Sampaio L.A., Acute tolerance and histopathological effects of ammonia on juvenile maroon clownfish *Premnas biaculeatus* (Block 1790), *Aquac. Res.*, **45**(7), 1133–1139 (2014)
52. Rosenwinkel K., Beier M., Phan L. and Hartwig P., Conventional and Advanced Technologies for Biological Nitrogen Removal in Europe, *Water Pract. Technol.*, **4**, 1–8 (2009)
53. Rusten B. and Ødegaard H., Design and Operation of Nutrient Removal Plants for very low effluent concentrations, *Proc. Water Environ. Fed.*, **2**, 1307–1331 (2007)
54. Sánchez Guillén J.A., Jayawardana L.K.M.C.B., Lopez Vazquez C.M., de Oliveira Cruz L.M., Brdjanovic D. and van Lier J.B., Autotrophic nitrogen removal over nitrite in a sponge-bed trickling filter, *Bioresour. Technol.*, **187**, 314–325 (2015)
55. Shi Y., Wu G., Wei N. and Hu H., Denitrification and biofilm growth in a pilot-scale biofilter packed with suspended carriers for biological nitrogen removal from secondary effluent, *J. Environ. Sci.*, **32**, 35–41 (2015)
56. Sliekers A.O., Derwort N., Gomez J.C., Strous M., Kuenen J.G. and Jetten M.S.M., Completely autotrophic nitrogen removal over nitrite in one single reactor, *Water Research*, **36**(10), 2475–2482 (2002)
57. STOWA, Treatment of nitrogen rich return flows of sewage treatment plants, Evaluation of Dutch pilot plant research projects (in Dutch), STOWA report, 95-08 (1995)
58. Sytek-Szmeichel K., Podedworna J. and Zubrowska-Sudol M., Efficiency of wastewater treatment in SBR and IFAS-MBSBBR systems in specified technological conditions, *Water Sci. Technol.*, **73**, 1349–1356 (2016)
59. Third K.A., Sliekers A.O., Kuenen J.G. and Jetten M.S.M., The CANON System (Completely Autotrophic Nitrogen-removal Over Nitrite) under Ammonium Limitation: Interaction and Competition between Three Groups of Bacteria, *Syst Appl Microbiol*, **24**, 588–596 (2001)
60. Tijhuis L., Loosdrecht M.C.M. van and Heijnen J.J., Nitrification with Biofilms on Small Suspended Particles in Airlift Reactors, *Water Sci. Technol.*, **26**, 2207–2212 (1992)
61. Tijhuis L., van Benthum W.A., van Loosdrecht M.C. and Heijnen J.J., Solids retention time in spherical biofilms in a biofilm airlift suspension reactor, *Biotechnol. Bioeng.*, **44**, 867–879 (1994)

62. Turk O. and Mavinic D.S., Preliminary assessment of a shortcut in nitrogen removal from wastewater, *Can. J. Civ. Eng.*, **13**, 600–605 (1986)
63. Uprety K., Evaluation of Glycerol and Waste Alcohol as Supplemental Carbon Sources for Denitrification, Ph.D. diss., Virginia Tech (2013)
64. Van Rijn J., Tal Y. and Schreier H.J., Denitrification in recirculating systems: Theory and applications, *Aquac. Eng.*, **34**, 364–376 (2006)
65. Veuillet F., Lacroix S., Bausseron A., Gonidec E., Ochoa J., Christensson M. and Lemaire R., Integrated fixed-film activated sludge ANITATMMox process--a new perspective for advanced nitrogen removal, *Water Sci. Technol.*, **69**, 915–922 (2014)
66. Volcke E.I.P., Picioreanu C., De Baets B. and van Loosdrecht M.C.M., Effect of granule size on autotrophic nitrogen removal in a granular sludge reactor, *Environ. Technol.*, **31**, 1271–1280 (2010)
67. Wang L., Wang X., Yang F., Kong M., Peng F., Chao J., Gao Y., Wu D., Zhu Y. and Zhang Y., Nitrogen removal performance and ammonia- and nitrite-oxidizing bacterial community analysis of a novel industrial waste-based biofilter, *Chem. Eng. J.*, **299**, 156–166 (2016)
68. Wu X., Yang Y., Wu G., Mao J. and Zhou T., Simulation and optimization of a coking wastewater biological treatment process by activated sludge models (ASM), *J. Environ. Manage.*, **165**, 235–242 (2016)
69. Xiao Y., Xiao Q. and Xiang S., Modeling of Simultaneous Partial Nitrification, Anammox and Denitrification Process in a Single Reactor, *J. Environ. Anal. Toxicol.*, **4**, 204 (2014)
70. Yang Q., Peng Y., Liu X., Zeng W., Mino T. and Satoh H., Nitrogen Removal via Nitrite from Municipal Wastewater at Low Temperatures using Real-Time Control to Optimize Nitrifying Communities, *Environ. Sci. Technol.*, **41**, 8159–8164 (2007)
71. Zhang X., Chen X., Zhang C., Wen H., Guo W. and Ngo H.H., Effect of filling fraction on the performance of sponge-based moving bed biofilm reactor, *Bioresource Technology*, **219**, 762–767 (2016).

(Received 09<sup>th</sup> March 2017, accepted 02<sup>nd</sup> May 2017)

\*\*\*\*\*